



**MAINTENANCE AND OPERATING INSTRUCTIONS
MODEL 39-017 MOTOR-GENERATOR
"NOBRUSH" VOLTAGE REGULATED
PERMANENT MAGNET FREQUENCY CONVERTER
VERTICAL TYPE**

GEORATOR Corporation
9617 Center Street
Manassas, Virginia 20110
USA
800-523-9938, 703-368-2101, fax 703-368-1078
WWW.Georator.com

GEORATOR CORPORATION
Manassas, Virginia

NOTE

Some instructions are general in nature. Some particular models may vary in size and precise locations for components. However, we believe that the user will be able to make those adjustment mentally. If you are at all concerned, please feel free to contact Georator Corporation with any questions you may have.



SPECIFICATION
GEORATOR CORPORATION
 MANASSAS, VIRGINIA 20110

Model No. 39-017
 Type 75-A Vertical Converter - Back Iron Regulated

1.0 INPUT:

- 1.1 Motor: Synduction, Stator And Rotor, Frame Size 280EE; 7.5 HP, 3 Phase, 60 Hz, 220/440V, 1200 RPM
 Georator P/N 18-630.
- 1.2 Input Current: 32/16 Amperes
- 1.3 Insulation: Class B
- 1.4 Max. Ambient Temperature: 40 Degrees C
- 1.5 Duty: Continuous

2.0 OUTPUT:

- 2.1 Rating: 5.0 KVA, 90% PF, 1 Phase, 400 Hz, 115/230V
- 2.2 Output Voltage, No Load; AC Values Before Regulation &
 Rectification:
 - (A) Power Winding: 145 +-2V Each Coil
 - (B) Control Winding: 59 +-1V L-L
- 2.3 Output Frequency Tolerances: 400 Hz Exact (NL To FL)
- 2.4 Voltage Regulation: +-1.5% NL To FL
- 2.5 Voltage Adjustment: +-5%
- 2.6 Output Current Rating: 43.4/21.7 Amperes
- 2.7 Insulation: Class B
- 2.8 Max. Ambient Temperature: 40 Degrees C
- 2.9 Dielectric Strength, Winding To Frame: 1500V For 1 Min.

3.0 VIBRATION: Within 0.0015

4.0 BEARINGS: Shielded Life Time Lubricated Bearings

5.0 FINISH:

- 5.1 Primer: Modified Alkyd Resin Red fed std TT-P664D
- 5.2 Paint: Silver-Blue Enamel
- 5.3 Fasteners: Zinc Plated

6.0 APPROXIMATE WEIGHT:

- 6.1 Net: 510 Lbs.
- 6.2 Shipping: 610 Lbs.

Revision Letter	Date	Revision Description
ENGINEER		M.T.E.
APPROVED BY		April 20, 1998

GEORATOR CORPORATION
Manassas, Virginia

MAINTENANCE AND OPERATING INSTRUCTIONS
39-017 MOTOR-GENERATOR
"NOBRUSH" VOLTAGE REGULATED
PERMANENT MAGNET FREQUENCY CONVERTER

GENERAL

The "NoBrush" vertical converter is a vertically mounted motor generator set used to convert 60 Hz frequency to 400 Hz frequency. The lower portion consists of the generator and the upper the motor.

The motor and generator, the control windings, and the control electronics are all packaged together in a single unit. The motor stator windings, the generator stator windings, and the control toroidal winding are mounted within the cast aluminum housing. The rotors for the motor and generator are mounted on a single common shaft with bearings at either end of the shaft. The electronic controls, consisting mainly of a single printed circuit board and heat sink, are mounted in an enclosure on the lower case of the motor-generator. An adjustment knob for setting the output voltage to a desired specific value (plus or minus 5% of rated regulated voltage at full load) is provided on the side of the control enclosure.

The drive motor is the induction type which means that it is very simple in construction and operation, and practically maintenance free. The rotor is the die cast aluminum squirrel cage type. The stator is wound for dual voltage input operation.

The Georator Corporation "NoBrush" alternator is probably the most reliable, rugged and trouble free generator built. The rotor consists of permanent magnets integrally cast in aluminum with the hub and pole pieces providing the field. Brushes, slip rings, etc. and their associated maintenance problems are eliminated. The stator is the armature.

The generator has internal protection against demagnetization from short circuit and will not be adversely affected by a short across its terminals for a short time duration.

**NOTE: DO NOT APPLY EITHER AC OR DC TO ANY OF THE
WINDINGS OF THE GENERATOR**

A voltage applied to the generator leads may cause the rotor magnets to demagnetize or damage the stator.

A connection diagram will be found in the terminal box or on the connection diagram plate. Suitable overload protection should be provided, based on full load ampere rating shown on the

name plate. Protect wiring circuits with proper size fuses selected according to local code requirements.

DESCRIPTION OF REGULATION METHOD

This regulated motor-generator utilizes the basic "NoBrush" generator with its permanent magnet rotor and normal stator windings. Supplementing these windings is a control toroidal winding, running from the bottom of the tooth slots to the back of the stator core. Through this toroidal winding is passed a direct current of sufficient magnitude to saturate the core to the degree required for attainment of a constant output voltage.

The output voltage is constantly sensed and any departure there from causes (via the control electronics) an increase or decrease in the direct current flowing through the toroidal winding. This, in turn, controls the amount of working flux passing through the stator core, which in turn determines the output voltage generated. The direct current necessary for energizing the toroidal winding is obtained from a separate control transformer feeding the regulator rectifier assembly. The power loss in the regulator circuitry is kept to a low figure.

Due to the design of the toroidal winding, the wave form of the machine is not impaired and approaches an ideal sine wave.

MAINTENANCE OF THE CONVERTER

Cleaning

It is most important that accumulations of oil, water, dirt, and dust are not permitted to cover the machine, enter it, or block ventilation. Remove any such accumulations from the machine and surrounding operating area.

Wipe the exterior of the machine to keep it clean. When necessary, use a suitable solvent to remove dirt accumulations from the machine surface.

Electrical machines should be protected from and kept free of acids, alkalines, chemical compounds and gas fumes that may cause insulation deterioration.

Clean Windings

Accumulations of any foreign materials should be kept off the windings. Failure to keep the windings clean may result in short circuits, grounding of insulated surfaces, and in increased temperature rise.

The frequency of cleaning windings will have to be determined by operating conditions.

However, it is a good policy to clean the windings at least once a year. Greasy or oily deposits may be wiped off with a lint-free cloth dipped in a suitable solvent. Take care not to leave solvent deposits on the windings. Light accumulations of nonconductive dust may be removed by compressed air. Use a pressure range of 40 or 60 psi. Do not blow directly into the windings. When dirt and dust accumulations are heavy or of a highly conductive nature, it is best to use an especially built vacuum cleaner to clean the machine. Follow the cleaner instructions carefully.

Solvents

When the parts of a motor and generator need cleaning, use a suitable petroleum solvent such as kerosene, petroleum spirits or Stoddard solvent. Care must be taken to utilize solvents in accordance with the solvent manufacturer's instructions. Protection in accordance with local laws regarding fire hazards must be provided. Gasoline containing lead compounds should not be used because of their toxic nature. Light petroleum solvents may be more effective but must be free of corrosive action and must be followed up with flushing oil.

BEARINGS

Bearing life is estimated at more than 10,000 operating hours for normal operating conditions. Bearing replacement is required only when the bearings become noisy. This requires the disassembly of the unit.

CONVERTER DISASSEMBLY

Disassemble converter for replacement of bearings. Use the following steps:

1. Remove 4 bolts, Item 2, from the top of the converter.
2. Remove 4 bolts, Item 5, from the motor flange.
3. Put a steel bar approximately 3/4" diameter through the eye bolts, and with a hoist slowly lift up motor housing, Item 7.
4. Screw into the end of the exposed shaft a 3/8-16 eye bolt and with a hoist slowly lift the shaft assembly, Item 1. The magnetic force will tend to hold the shaft assembly in place and it will be necessary to secure the generator housing, Item 1, to the work bench or floor.
5. Protect the generator rotor, Item 3, by wrapping it in heavy paper, and place it away from the iron or steel objects. If magnetic materials adhere to the rotor, this could cause partial demagnetization of the rotor. Iron and steel objects should be kept some distance from the rotor.

Removal of the shaft assembly will permit complete inspection of the generator and motor windings and removal of the bearings, Items 1, from the shaft assembly, using a proper size bearing puller. They should be removed in the same manner as when mounted; that is, from the shaft by force applied to the inner race only.

INSTALLATION OF THE BEARINGS

The shaft bearing seat and bearing housing must be carefully cleaned to remove all traces of metal chips, filings, etc. To drive the inner ring of a bearing on a cylindrical shaft seat, a piece of tubing, squared on the ends should be used that will bear evenly against the face of the inner ring. Pressure should not be applied to the inner ring through the ball assembly by pushing against the outer ring. The bearing should be driven to a firm seat on the shaft shoulder.


Care must be taken that the bearing is started true and not cocked; otherwise, it is possible to roughen or burr the ground surface of the shaft. A light film of oil on the shaft and in the housing bore will prove an aid to mounting.

Do not force the bearing onto a shaft by blows applied to the outer race, nor into a housing by pounding upon the inner race.


To reassemble the converter reverse the order of the disassembly taking care not to damage the generator and motor windings. Clean any metal chips or particles from the rotors before installation. Check to see that the generator rotor turns freely and does not rub the stator. The generator leads should not be shorted when checking for a free turning rotor.



There should be a minimum air gap of at least 0.017 inches all around. This can be checked with a non-magnetic feeler gauge of the proper thickness and about 1/8 inch wide, through the inspection slots, located on the bottom of the generator housing. After inspection, be sure the inspection slots are closed with cover, Item 6.

ITEM	DESCRIPTION	QTY	ITEM	DESCRIPTION	QTY
1	SHAFT, ASSY.	1	40	BOLT, 1/2-13 X 2, HEX HD	1
A	SHAFT	1	41	BOLT, 1/2-13 X 1-1/2, HEX HD	4
B	ROTOR, GENERATOR	1	42	BOLT, 3/8-16X1, HEX HD	4
C	KEY, WOODRUFF	2	43	BOLT, 1/4-20X2, HEX HD	9
D	ROTOR, MOTOR	1	44	BOLT, 1/4-20X1-1/4, HEX HD	4
E	GREASE SHIELD	1	45	BOLT, 1/4-20X1-1/4, HEX HD	4
F	BEARING	1	46	BOLT, 1/4-20X3/4, HEX HD	24
G	BEARING	1	47	CAP. SCREW, 1/4-20 X 1-1/4, SOCKET HD	6
H	FAN	1	48	SCREW, 10-32 X 5/8, RND. HD	16
			49	SCREW, 10-32 X 1/2, RND. HD	8
2	HOUSING, GENERATOR	1	50	SCREW, #10X5/8, SELF-TAPPING, HEX. HD.	8
3	STATOR ASSY., GENERATOR	1	51	SCREW, #10X1/2, SELF-TAPPING, HEX. HD.	10
4	WASHER, RETAINING	20	52	SCREW, 6-32X3/4, BINDING HD.	2
5	FEET	1	53	SCREW, 4-40X1/4, RND. HD	2
6	SCREEN, INSPECTION	4	54	SCREW, #4X1/4, DRIVE, RND. HD, TYPE U, STL	2
7	PLUG, GENERATOR HOUSING	1	55	SCREW, #0X3/16, DRIVE RND. HD	4
8	HOUSING, MOTOR	1	56	LOCKWASHER, 1/2, MDM. SPLIT, STL.	6
9	BAFFEL, GENERATOR	1	57	LOCKWASHER, 3/8, MDM. SPLIT, STL.	13
10	STATOR ASSY. MOTOR	1	58	LOCKWASHER, 1/4, MDM. STL.	42
11	SPRING WASHER	1	59	LOCKWASHER, #10, MDM. SPLIT, STL.	24
12	END BELL	1	60	LOCKWASHER, #6, MDM. SPLIT, STL.	2
13	HOUSING, VOLTAGE REGULATOR	1	61	LOCKWASHER, #4, MDM. SPLIT, SST.	2
14	VOLTAGE REGULATOR	1	62	FLATWASHER, 1/4, STL.	8
15	DIAL PLATE, INCREASE	1	63	FLATWASHER, #10, STL.	16
16	LOCK KNOB	1	64	NUT, 6-32, HEX. HD.	2
17	CONTROL KNOB	1	65	SPIROL PIN, Ø5/16X1, STL.	1
18	LEGEND PLATE, VOLTAGE	1	66	SPIROL PIN, Ø5/16X1-3/4, STL.	2
19	COVER, VOLTAGE REGULATOR	1	67	CAPSCREW, 1/4-20X 1-3/4, SOCKET HD, STL.	4
20	EMBLEM	1	68	INDUCTOR, MDHAWK ELECTRO	1
21	LIFTING BRACKET	2			
22	TERMINAL BOX, MOTOR	1			
23	GASKET, TERMINAL BOX PAD	1			
24	TERMINAL BOX, GENERATOR	1			
25	TERMINAL BOX COVER	2			
*	GASKET	2			
26	TERMINAL BOARD	1			
27	CONN. DIAG. PLATE, 3 PHASE INPUT	1			
28	WIRING HARNESS	1			
29	CABLE CLAMP	2			
30	NAME PLATE	1			
*	WARNING LABEL	2			

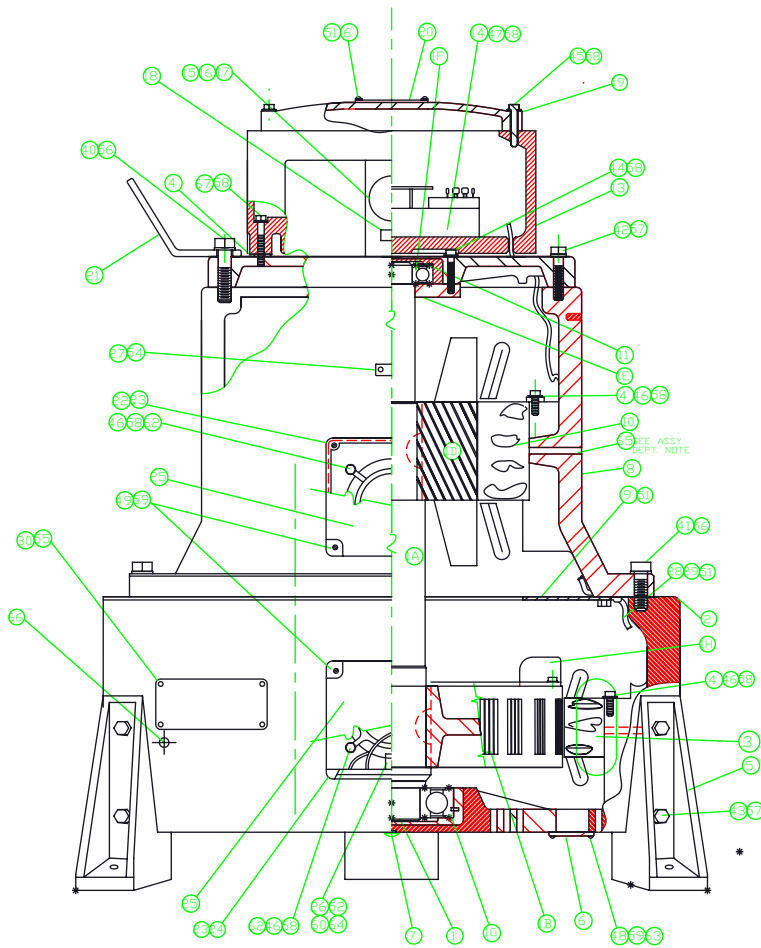

ASSY DEPT. NOTE
 D) 5/16" (312) DRILL X .12/09 DP. INTO MOTOR & GEN. STATOR FOR SPIROL PIN ITEM 65 & 66 (TYP 3 PLACES)

				UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES.		 GEORATOR Corporation 3617 Center Street Manassas, VA 20110-5521, USA Telephone (703)-368-2101 FAX (703) 368-1078	
				UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES. DO NOT SCALE DRAWING.		NAME: ASSEMBLY DRAWING	
				PLOT @: TO FIT DATE: 3-10-88 DRAWN: J.M.		MATERIAL: VERT. CONV. B.I.R., TYPE 75-A SERIES	
				THIS DRAWING AND ANY PRINT THEREOF IS THE PROPERTY OF GEORATOR CORPORATION AND IS SUBJECT TO RETURN ON REQUEST BY THIS COMPANY. THE INFORMATION SHOWN IS CONFIDENTIAL AND THE RECIPIENT BY ACCEPTING THIS DRAWING AGREES NOT TO USE ANY INFORMATION CONTAINED THEREIN IN ANY MANNER WHICH WILL BE DETRIMENTAL TO GEORATOR CORPORATION.		SEE BILL/LIST OF MATERIAL	
A				DRAWN ON CAD		DATE: 5-5-08	
REV.				DESCRIPTION		DATE BY	
				SCALE: NONE		FINISH: DWG. NO. D 22-535	
				SHEET 1 OF 1		REV.	

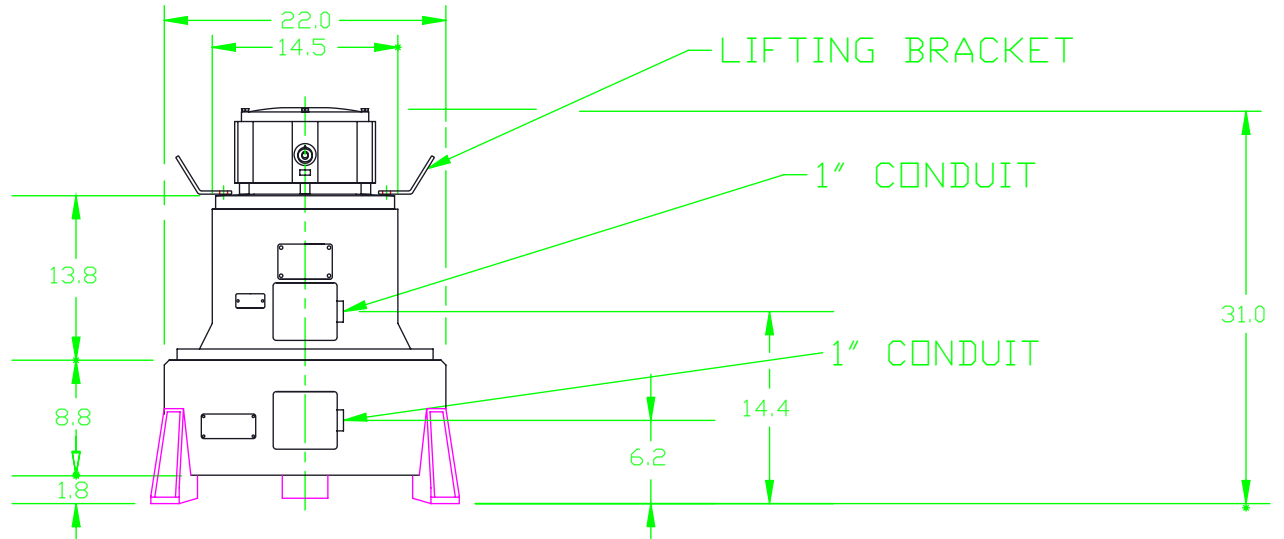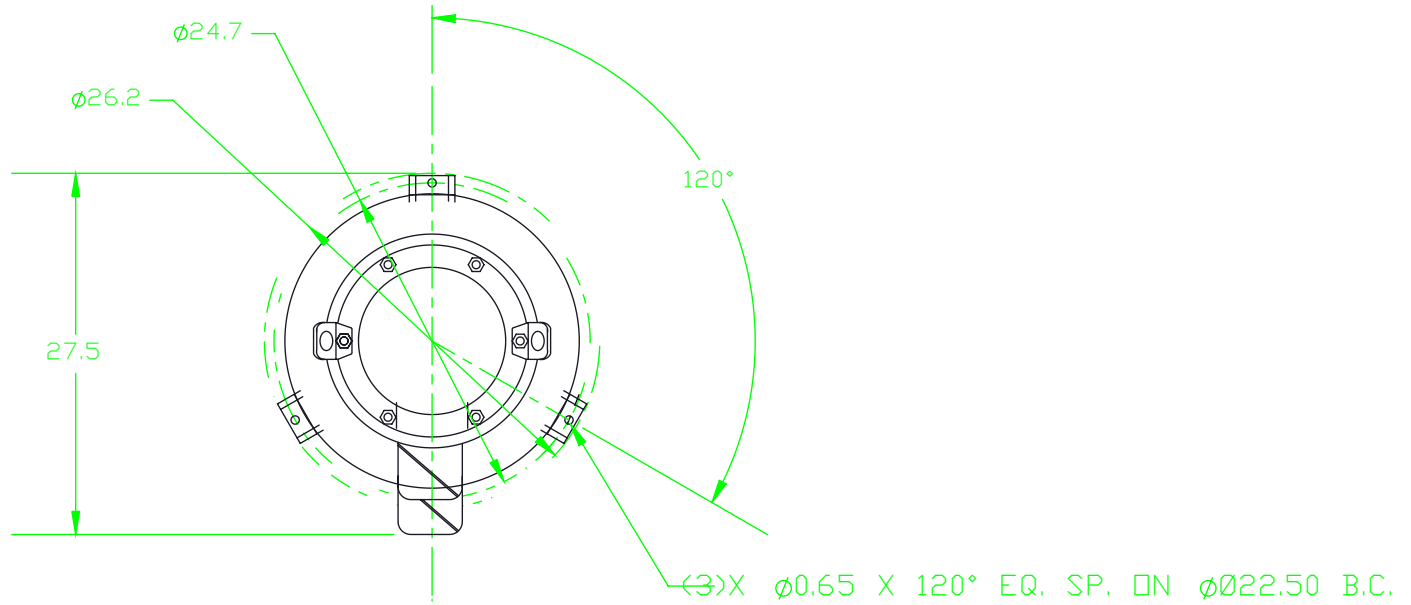

UNSPECIFIED TOLERANCES
 FRACTIONAL $\pm 1/8$
 DECIMAL ± 0.030
 2 PLACE N/A
 3 PLACE N/A
 ANGULAR N/A

UNLESS OTHERWISE
 SPECIFIED DIMEN-
 SIONS ARE IN
 INCHES.

Georator Corporation
 9617 Center Street Manassas, VA 20110-5521, USA
 Telephone (703)-368-2101 FAX (703) 368-1078

PLOT @: FIT

DO NOT SCALE DRAWING

NAME
 OUTLINE DRAWING
 VERTICAL CONVERTER- 40 POLE B.I.R.

This drawing and any print thereof is the property of Georator Corporation and is subject to return on request by this company. The information shown is confidential and the recipient by accepting this drawing agrees not to use any information contained therein in any manner which will be detrimental to Georator Corporation.

DATE 5-4-88
 DRAWN J.M.
 FILE: 23-1055.DWG
 APP'D.
 SCALE NONE

MATERIAL SEE BILL/LIST OF MATERIALS
 FINISH
 DWG. NO. A 23-1055
 SHEET 1 OF 1
 REV A

REV.	DESCRIPTION	DATE	BY
A	DRAWN ON CAD	5-07-08	FM

OUTPUT


5kVA, 1 PH., 400Hz (NOM.)

INPUT

3 PH, 60 Hz


7.5 H.P.

LOW VOLTAGE




220V

HIGH VOLTAGE




440V

POWER WINDING

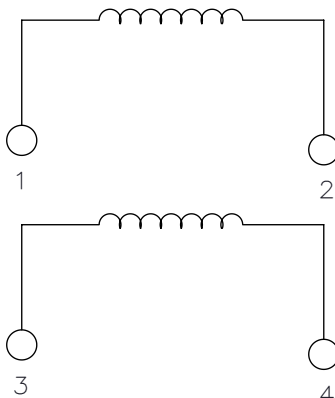

BACK IRON WINDING


CONTROL WINDING

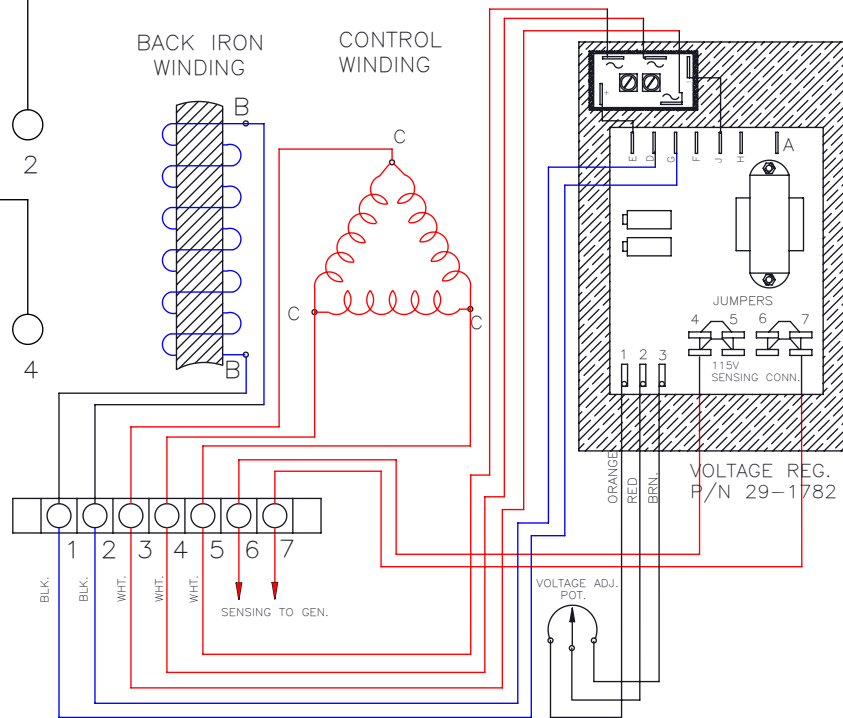

B = 208V
A = 120V
TO TB #6, #7
WYE SENSING 230V



TO TB #6, #7
DELTA SENSING 115V
A=120V



REV	DESCRIPTION	DATE	BY	UNSPECIFIED TOLERANCES FRACTIONAL +1/32 DECIMAL .2 PLACE +0.00 .3 PLACE -0.00 ANGULAR +1/2	UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES	Georator Corporation 9617 Center Street Manassas, VA 22110-5521, USA Telephone (703)-368-2101 FAX (703) 368-1078				
A	DRAWN ON CAD	05-19-08	FM	PLOT @- XXXXXX	DO NOT SCALE DRAWING	NAME	WIRING DIAGRAM			
				This drawing and any print thereof is the property of Georator Corporation and is subject to return on request by this company. The information shown is confidential and the recipient by accepting this drawing agrees not to use any information contained thereon in any manner which will be detrimental to Georator Corporation.	DATE 2-29-00	MODEL NO. 39-017				
					DRAWN M.T.E.	MATERIAL				
					FILE: 25-1243.dwg	FINISH		DWG. NO.		REV.
					APP'D.	SCALE NONE		SHEET 1 OF 1		A 25-1243